SAFETY ORGANIZATIONS

THIS FILTER HAS BEEN FORMALLY RECOGNIZED, CERTIFIED OR APPROVED BY THE LISTED AGENCY. THEREFORE, ALL TEST/REQUIREMENTS SPECIFIED IN THE LATEST REVISION OF THE FOLLOWING AGENCY STANDARDS HAVE BEEN MET:

UL RECOGNIZED: UL 1283 CSA CERTIFIED: CSA 22.2, #8 VDE APPROVED: EN 133 200

OPERATING SPECIFICATIONS

LINE CURRENT/VOLTAGE: 6 AMP 120/250VAC

6 AMP/40°C, 250VAC

LINE FREQUENCY: 50-60Hz

MAXIMUM LEAKAGE CURRENT,

EACH LINE TO GROUND: 0.22 mA@ 120V 60Hz 0.38 mA@ 250V 50Hz

OPERATING AMBIENT TEMP. RANGE: -10°C TO +40°C @ RATED CURRENT, Ir. IN AN AMBIENT, To, HIGHER THAN 40°C, THE MAXIMUM OPERATING CURRENT, Io, IS AS FOLLOWS: I o = I r $\sqrt{85-T_0}$

RELIABILITY SPECIFICATIONS:

STORAGE TEMPERATURE: -40°C TO +85°C HUMIDITY: 21 DAYS @ 40°C 95% RH. CURRENT OVERLOAD TEST: 6 TIMES I_r FOR 8 SECONDS

TEST SPECIFICATIONS:

INDUCTANCE: 0.465 mH NOMINAL

CAPACITANCE: (MEASURED @ 1KHz, 0.250VAC MAX., 25°C±1°C)

LINE TO GROUND: 0.0059 µF ±20% LINE TO LINE: 0.1015 µF ±20% DISCHARGE RESISTOR: 1.5M ^

L/G AND L/L I.R.
ND DISCHARGE RESISTOR: 6000M (MIN.

ISTOR: 6000M (MIN.) @ 100VDC, 20°C AND 50% RH

CATALOG #6EEJ2

PJO

DATE

05MAY03

ECN # APPRVD.

0631-0174-03


RECOMMENDED RECEIVING INSPECTION HIPOT:

LINE TO GROUND: 1500 VAC OR 2250 VDC FOR 1 MINUTE

LINE TO LINE: 1450 VDC FOR 1 MINUTE

FILTER APPROVAL:

THE BEST WAY TO SELECT AND QUALIFY A FILTER IS FOR YOUR ENGINEERING TO TEST THE UNIT IN YOUR EQUIPMENT

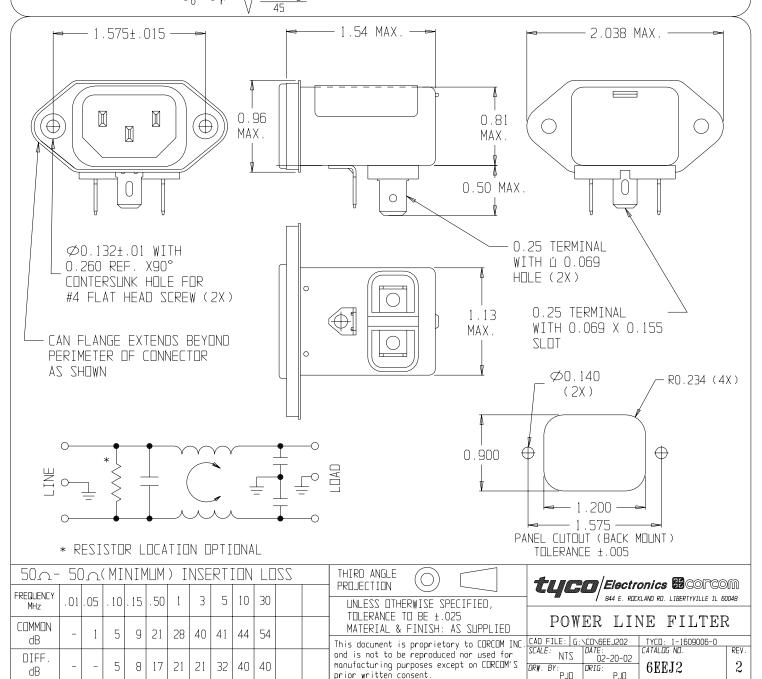

单击下面可查看定价,库存,交付和生命周期等信息

>>TE Connectivity(泰科)